


ADVANCED AEROBIC PROGRAMMER
 887 C.R. 4421 Rhome, Tx. 76078 (940)626-4640

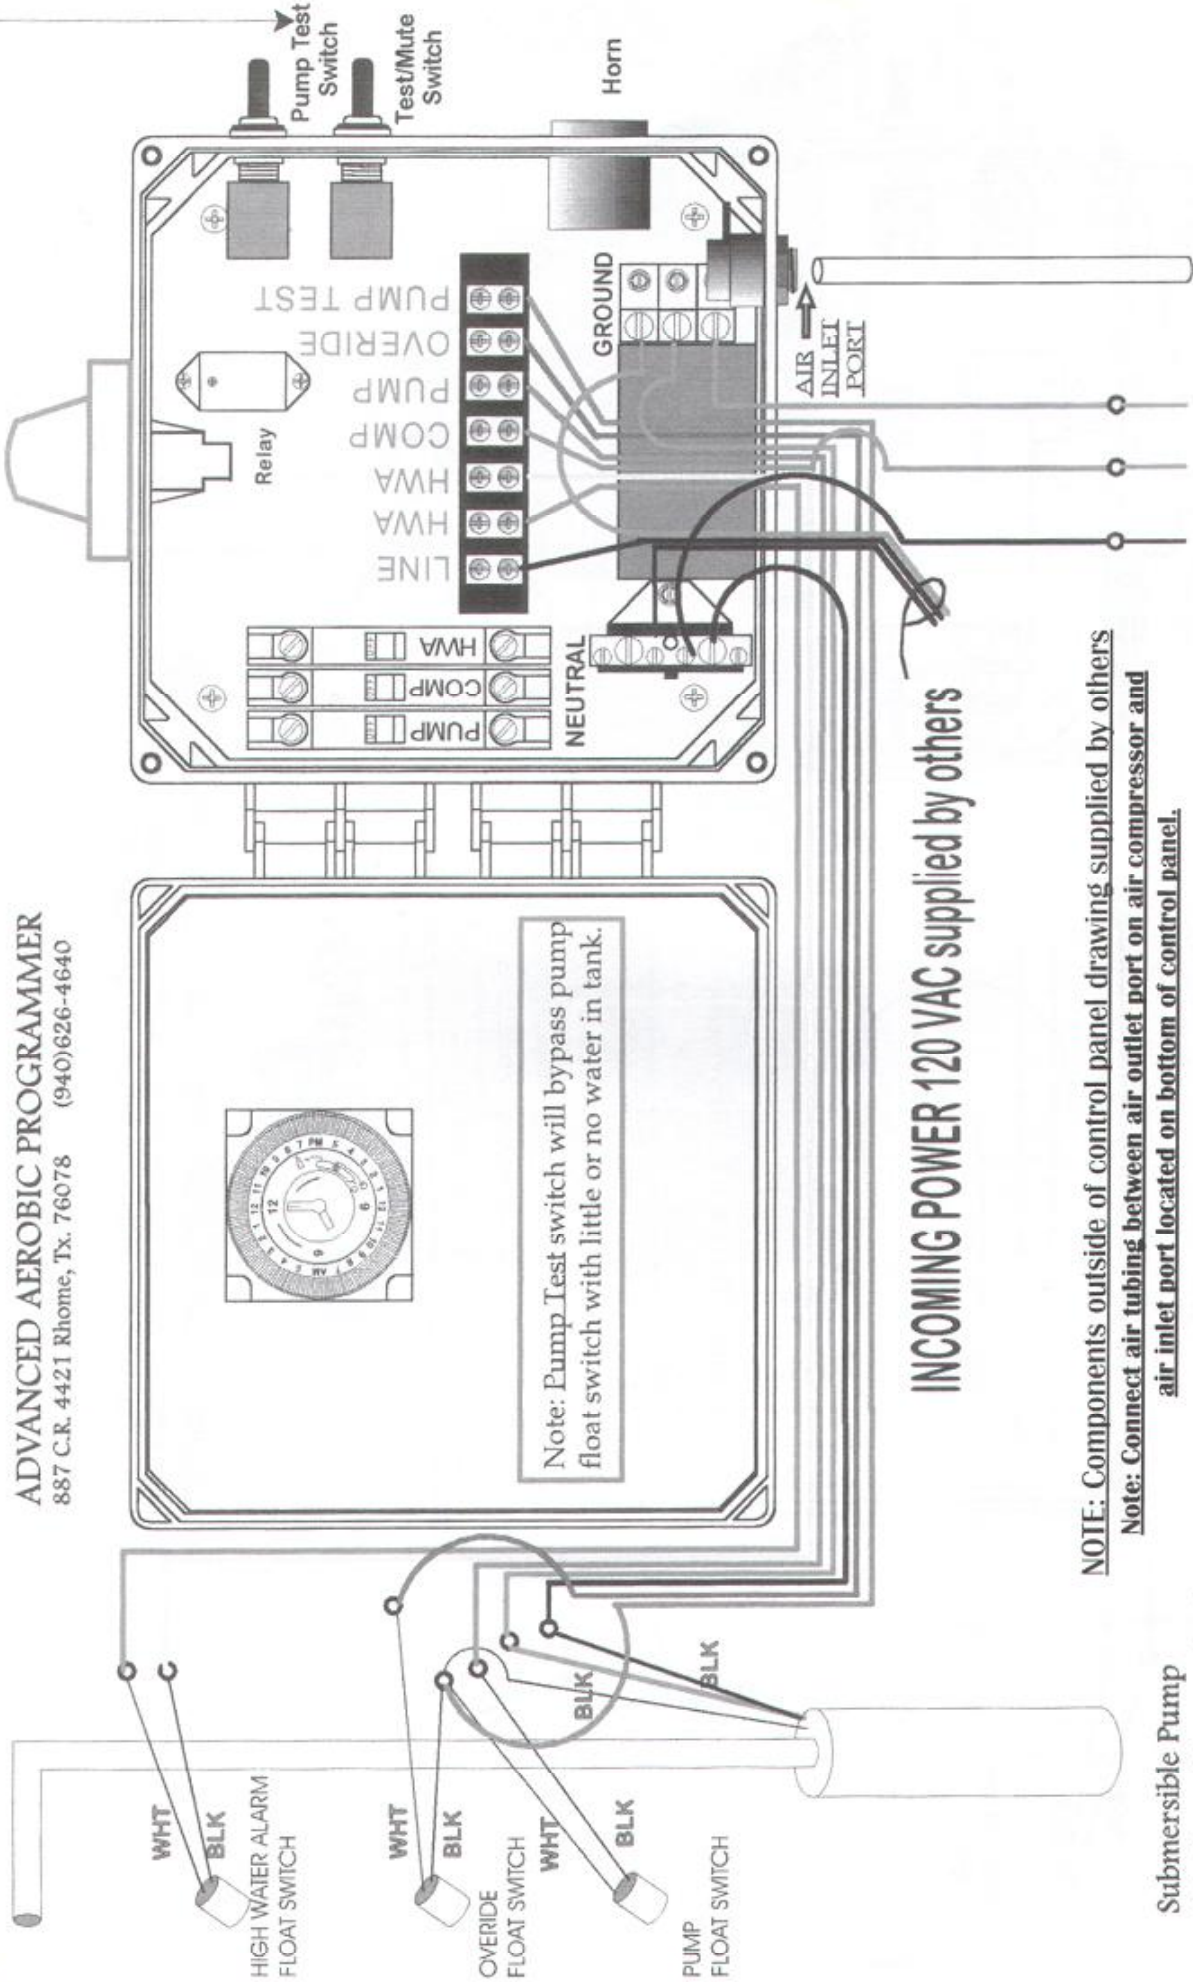

Note: Pump Test switch will bypass pump float switch with little or no water in tank.

Pump test switch will bypass pump float switch and operate pump.

INCOMING POWER 120 VAC supplied by others

NOTE: Components outside of control panel drawing supplied by others
Note: Connect air tubing between air outlet port on air compressor and air inlet port located on bottom of control panel.

Submersible Pump
 (Must be a U.L. recognized thermal protected motor)

Model PT

COMPRESSOR
 (Must be a U.L. recognized thermal protected motor)